

CircuitSolver® Union Assembly Thermal Disinfection Dual Valve with Thermometer (CSUASTD-D-TW)

[Thermostatic balancing valve with union body, ball valves, strainer, thermometer, and two actuators]

SUBMITTAL

JOB:	ORDER NO:	DATE:
	SUBMITTED BY:	DATE:
UNIT TAG:	APPROVED BY:	DATE:
CITY:	ENGINEER:	BUILDING TYPE:
STATE:	CONTRACTOR:	CONSTRUCTION TYPE:
COMPLETION DATE:		

DESCRIPTION

CircuitSolver® is a thermostatic balancing valve that automatically and continuously adjusts flow to maintain the desired temperature in a domestic hot water supply line. Since the CircuitSolver® responds to water temperature to control the flow entering the recirculation line it eliminates the need to manually balance the system.


The "CSUASTD-D-TW" version CircuitSolver® incorporates a second actuator to reopen the valve during a thermal disinfection process, an optional check valve, isolated ball valves, a strainer, and thermometer. The featured strainer (20 mesh) must be maintained in order to avoid flow obstruction.

DIMENSIONS

Item No.	Part Number	Description	Qty.
1	261-20X00X-XXX	CSUTD-D-1/2-XXX/YYY- (CV1)	1
2	92-160	BALL VALVE, 1/2" MxF, LF	2
3	92-162	1/2" x CL NIPPLE BRASS, LF	1
4	92-200	Y- STRAINER, 1/2" BRASS	1
5	93-172	1/2" X 1/2" TEE, BRASS	1
6	93-094	THERMOWELL	1
7	94-287	THERMOMETER	1

Item No.	Part Number	Number Description	
1	261-30X00X-XXX	CSUTD-D-3/4-XXX/YYY- (CV1)	1
2	92-158	BALL VALVE, 3/4" MxF, LF	2
3	92-026	3/4" X CL NIPPLE BRASS, LF	1
4	92-201	Y- STRAINER, 3/4" BRASS	1
5	93-173	3/4" X 1/2" TEE, BRASS	1
6	93-094	THERMOWELL	1
7	94-287	THERMOMETER	1

Item No.	Part Number	Description	Qty.
1	261-40X00X-XXX	CSUTD-D-1-XXX/YYY- (CV1)	1
2	92-170	BALL VALVE, 1" MxF, LF	2
3	92-044	1" X CL NIPPLE BRASS, LF	1
4	92-202	Y- STRAINER, 1" BRASS	1
5	93-174	1" X 1/2" TEE, BRASS	1
6	93-094	THERMOWELL	1
7	94-287	THERMOMETER	1

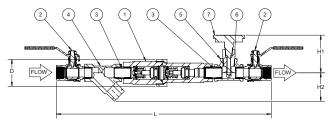



			neter D)	Leng	jth (L)		ight 11)	ı	ight 12)	We	ight	ı	Standard Balancing		Disin	ermal fection icing C _v	Ma Pres			ax. mp
Model No.	NPT	IN	MM	IN	MM	IN	MM	IN	MM	LBS	KG	OPEN	CLOSED	DESIGN	OPEN	CLOSED	PSIG	BAR	٥F	°C
CSUASTD-D-½-XXX/170-TW	1/2"	1.9	48.3	15.1	383.5	2.6	66	2.0	51	5.0	2.3	1.8	0.2	0.85	0.5	0.2				
CSUASTD-D-½-XXX/170-CV1-TW	1/2	1.9	48.3	15.1	383.5	2.0	00	2.0	51	5.0	2.3	1.8	0.2	0.85	0.5	0.2				
CSUASTD-D-¾-XXX/170-TW	3/4"	1.9	48.3	16.8	426.7	2.8	71.1	2.2	55.9	6.3	2.9	1.8	0.2	0.85	0.5	0.2	200	14	250	121
CSUASTD-D-3/4-XXX/170-CV1-TW	3/4	1.9	40.5	10.0	420.7	2.0	71.1	2.2	55.5	0.3	2.5	1.0	0.2	0.85	0.5	0.2	200	''	-00	'-'
CSUASTD-D-1-XXX/170-TW	1"	2.4	61	18.5	469.9	2.9	73.7	2.5	63.5	8.9	4.1	3.3	0.2	1.57	0.5	0.2				
CSUASTD-D-1-XXX/170-CV1-TW	Ι΄.	2.4	"	10.5	703.3	2.3	1 '3./	2.5	03.5	J 0.9	T. 1	0.5	0.2	1.57	0.5	0.2			l	

Model Number Selection


XXX refers to the desired closing temperature for standard balancing. When the water temperature drops below this point the CircuitSolver® will begin to open, allowing water to easily enter the return line. The valve will start to reopen approximately 20°F above the standard balancing temperature and rebalance the system at 170°F. For example, if you want 120°F desired return temperature and the CSUASTD-D-TW is to be installed on a 3/4" line, the model number would be CSUASTD-D-TW-3/4-120-170. To add optional check valve insert -CV1 to the end of the model number. Ex. CSUASTD-D-TW-3/4-120-170-CV1

^{*}ALL COMPONENTS ARE LEAD FREE

^{*}ALL COMPONENTS ARE LEAD FREE


^{*}ALL COMPONENTS ARE LEAD FREE



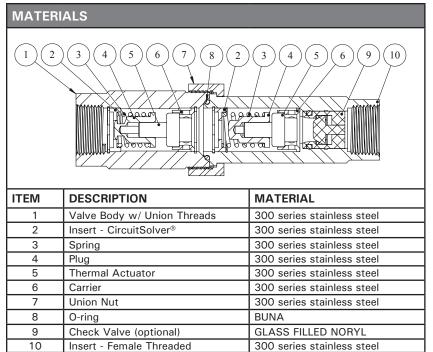

8	O-ring	BUNA
9	Check Valve (optional)	GLASS FILLED NORYL
10	Insert - Female Threaded	300 series stainless steel
FLOW R	ATE CALCULATION USING "(Cv" FACTOR

OPTIONAL CHECK VALVE Features and Benefits -100% factory tested drip tight operation -Snap fit design, no retainer needed -Extra-low head loss and low cracking pressure -External O-ring in groove Certifications -ANSI/ NSF 61 ITEM **MATERIAL** Cap Glass filled Noryl Guide Glass filled Noryl Plunger Glass filled Noryl Lip Spring EPDM rubber Stainless Steel AISI 301 Spring EPDM rubber O-rina

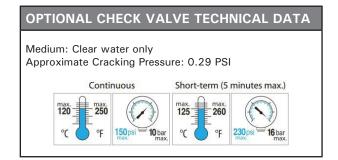

TYPICAL SPECIFICATION

- I. Furnish and install CIRCUITSOLVER® Thermal Disinfection Dual Balancing Assembly with Thermometer valve as indicated on the plans. CIRCUITSOLVER® assembly shall be self-contained and fully automatic without additional piping or control mechanisms. Valve shall be a CIRCUITSOLVER® as manufactured by ThermOmegaTech®, Inc. or equivalent.
 - A. CIRCUITSOLVER® assembly shall regulate the flow of recirculated domestic hot water based on water temperature entering the CIRCUITSOLVER® valve regardless of system operating pressure. As the water temperature increases the valve proportionally closes dynamically adjusting flow to meet the specified temperature.
 - 1. CIRCUITSOLVER® assembly never fully closes, even at the desired set point. There is always sufficient bypass flow back to the recirculating pump to prevent overheating or "dead heading" of the pump.
 - 2. CIRCUITSOLVER® assembly is set at the factory for the desired return temperature. No field adjustments needed. Several temperature set points are available.
 - 3. CIRCUITSOLVER® assembly shall be available in 1/2", 3/4" & 1" NPT.
 - B. CIRCUITSOLVER® assembly allows for an additional balancing cycle at 170°F.
 - 1. The valve will start to re-open above the low temperature balancing set point to allow high temperature water through during a thermal disinfection process. The valve will rebalance at the second temperature set point.
- II. CIRCUITSOLVER® body and all internal components are made with lead-free materials with major components constructed of type 300 series stainless steel.
 - A. CIRCUITSOLVER® assembly shall be rated to 200 PSIG maximum working pressure.
 - 1. CIRCUITSOLVER® assembly shall be standard tapered female pipe thread, NPT.
 - B. CIRCUITSOLVER® assembly shall be rated to 250°F (121.1°C) maximum working temperature.
 - C. Thermal actuator shall be spring-loaded and self-cleaning, delivering closing thrust sufficient to keep orifice opening free of scale deposits.
- III. Installation of CIRCUITSOLVER® assembly shall be made by qualified tradesmen. Install CIRCUITSOLVER® assembly in each domestic hot water return piping branch beyond last hot water device in that branch.
 - A. Provide suitable line size isolation valves, unions, and strainer as indicated in piping detail shown on the drawings.
 - B. Provide suitable access panel as required in non-accessible ceilings and walls.
 - C. Pay close attention to flow arrow, especially with valves that have an integrated check valve.

